

DOCUMENT 00 00 12

**ADDENDUM NO. 2
May 29, 2018**

**South Rivanna WTP - Residuals Clarifiers Decant System Installation
RFQ No. 1076
Rivanna Water & Sewer Authority**

SEH No. RIVAN 145827

From: Short Elliott Hendrickson Inc.
3535 Vadnais Center Drive
Saint Paul, MN 55110-5196

To: Document Holders

DOCUMENT HOLDERS on the above-named project are hereby notified that this document shall be appended to, take precedence over and become part of the original quotation documents dated May 10, 2018 for this work. Quotations submitted for the construction of this work shall conform to this document.

This addendum consists of 1 page and attached Drawing Sheets P1 and P2.

Clarifications and Notes

1. The Contractor will be allowed to drain the clarifiers for a preliminary verification of measurements in order to order the correct materials. The same time limits for taking a clarifier offline shall apply as specified in the Project Manual.

Changes to Specifications:

2. Section 40 23 30 Process Piping, Valves, & Specialties
 - a. Subparagraph 2.02.A.2., change to read: Brackets shall be supplied with minimum ½ inch thick back plates sized to distribute load over the wall.
 - b. Add the following subparagraph 2.02.A.4., Install stainless steel adhesive anchor bolts as recommended by the bracket manufacturer to attach to the clarifier wall.
 - c. Add the following subparagraph 2.02.A.5., Install stainless steel u-bolts, nuts, and washers, sized according to the corresponding pipe size, to secure the pipe to the wall bracket.


Changes to Drawings:

3. Replace Sheets P1 and P2 with attached updated Sheets P1 and P2.

Note: Receipt of this Addendum No. 2 (dated May 29, 2018) shall be acknowledged on Page 00 41 00-1 of the submitted Quote Form. Failure to do so may subject Quoter to disqualification.

END OF ADDENDUM

This Page Left Blank Intentionally

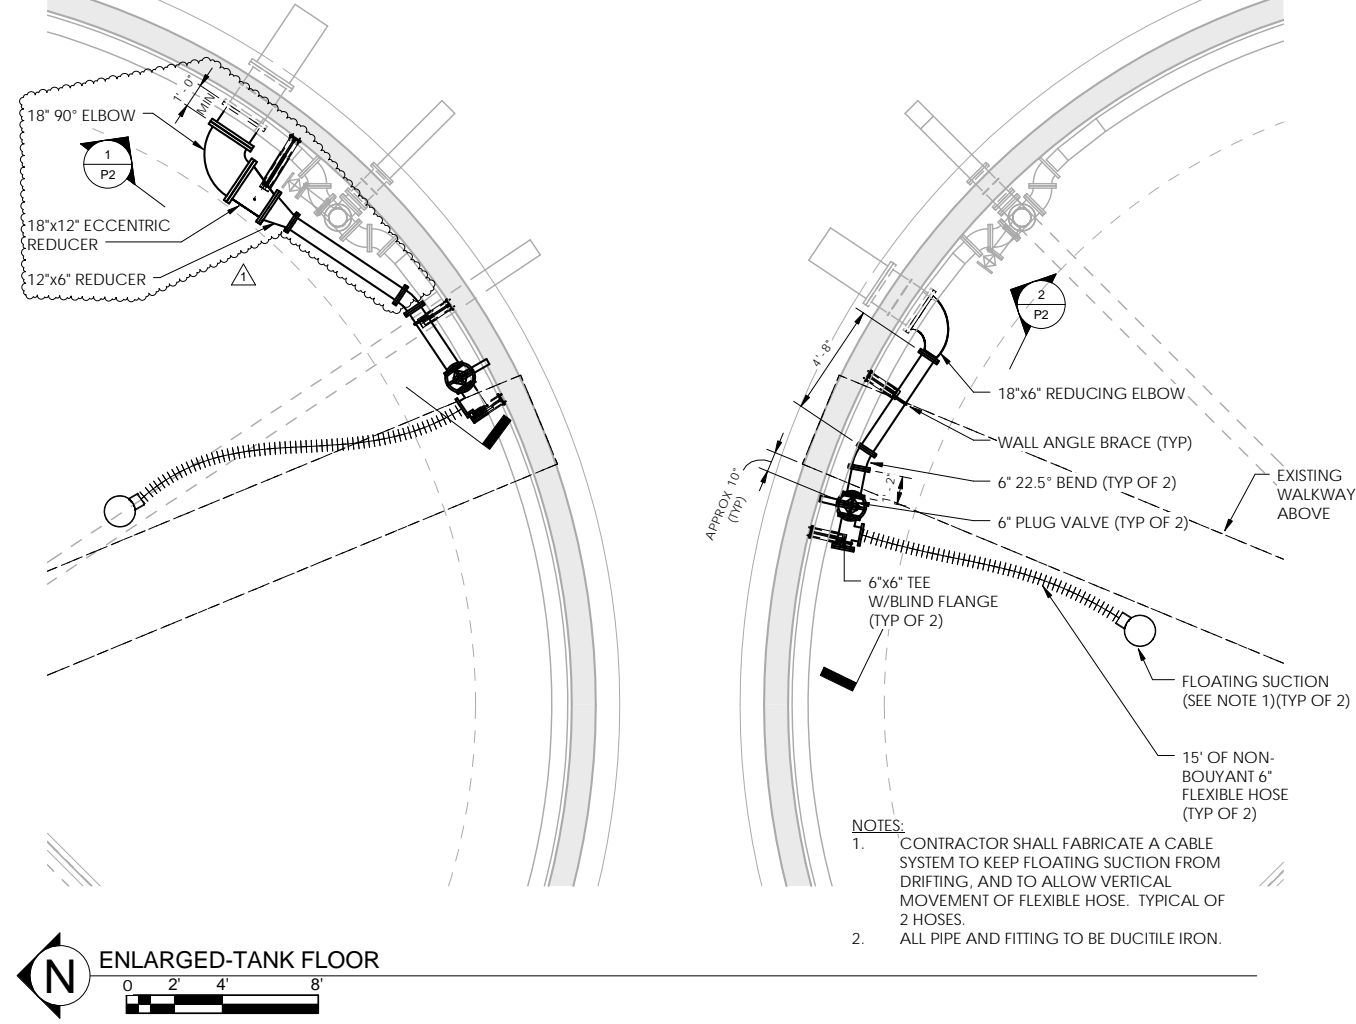

**SOUTH RIVANNA WATER TREATMENT
 PLANT CLARIFIER IMPROVEMENT
 PROJECT
 RIVANNA WATER & SEWER AUTHORITY
 ALBEMARLE COUNTY, VIRGINIA**

MARK	DATE	REVISIONS	APPENDIX NO. 2 DESCRIPTION
1	05-29-18		

FILE NO. RVAN145827	BID NOCS 05-10-2018
RWSA REF NO.	DESIGNED BY MBJ
PROJECT STATUS	DRAWN BY RWF
ISSUE DATE	


Shortt Eilat Heintz/Johnson, Inc. © (SEH)

SHEET TITLE
PROPOSED PLANS


SHEET
P1

S:\PT\RV\rvan14582715-final-dsgn\51-drawings\95-Revit Working Files\RVAN_145827_South WTP_Clarifier Improvements_2016.rvt


5/29/2018 1:19:44 PM

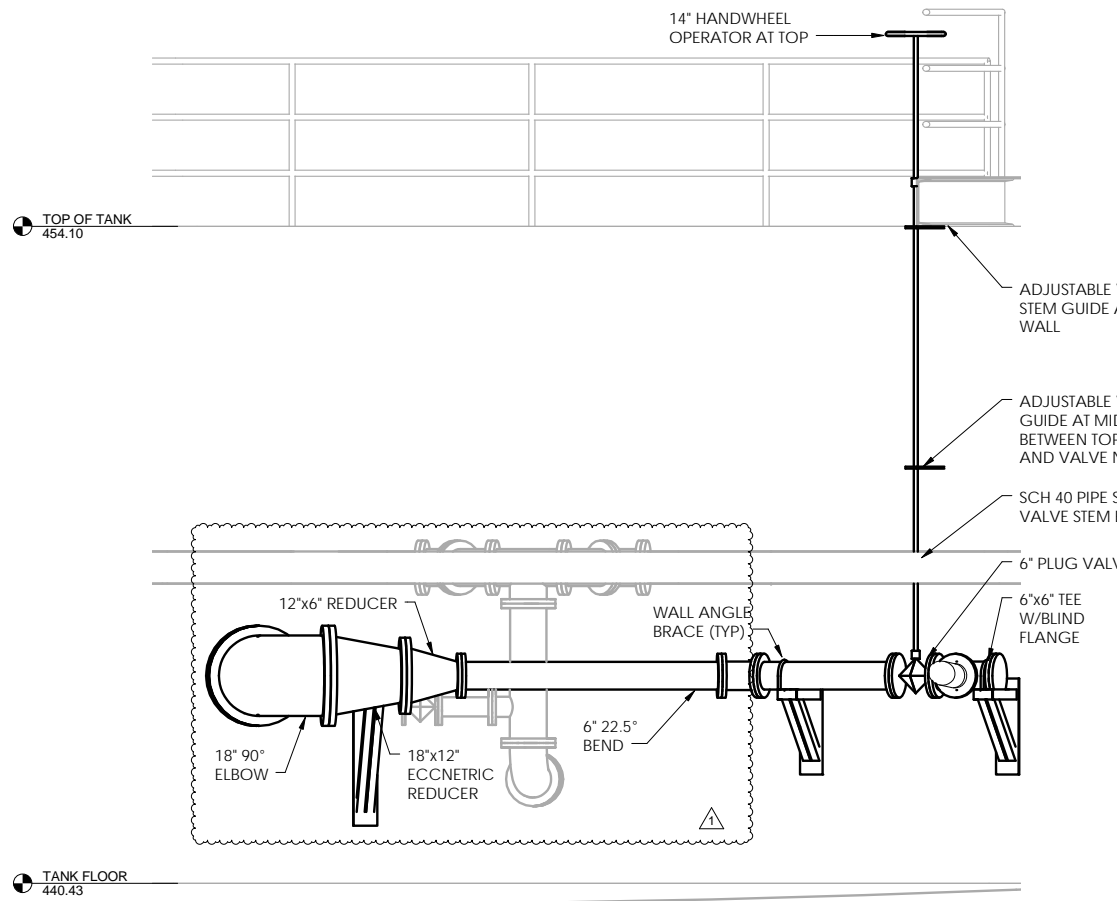

1 SECTION
P2
0 1' 2' 4'

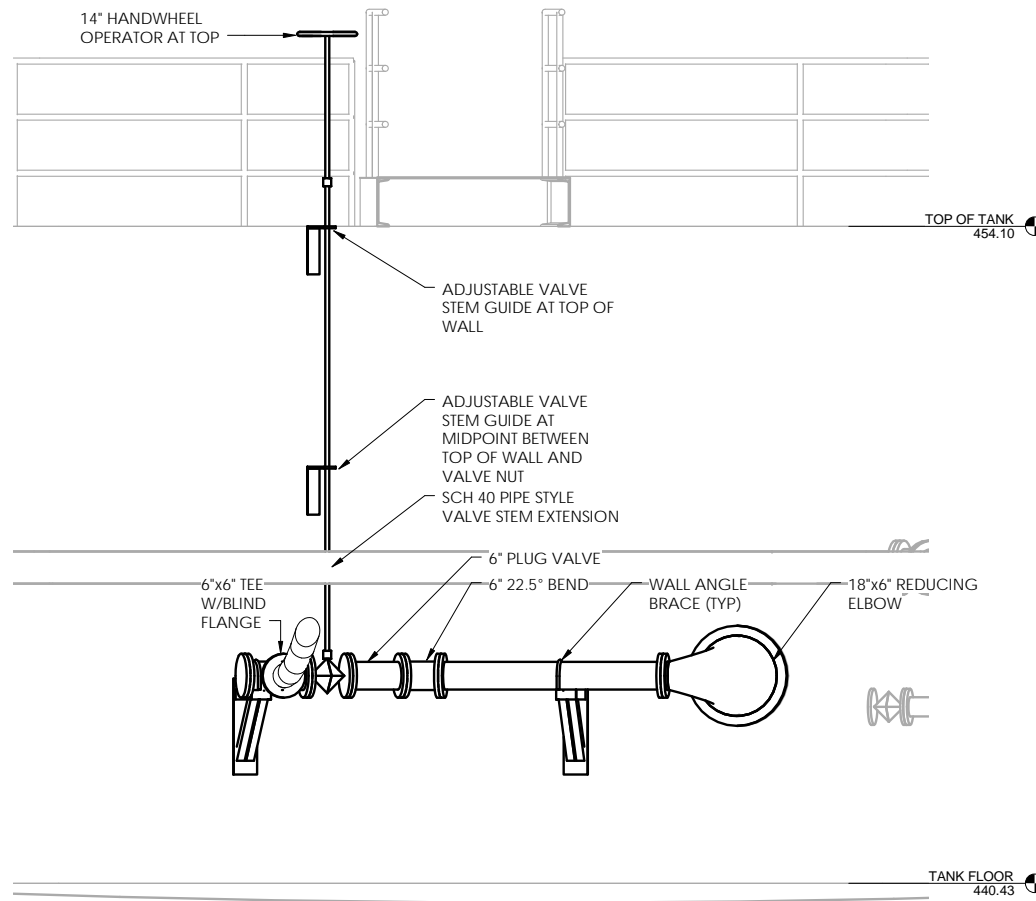

2 SECTION
P2
0 1' 2' 4'

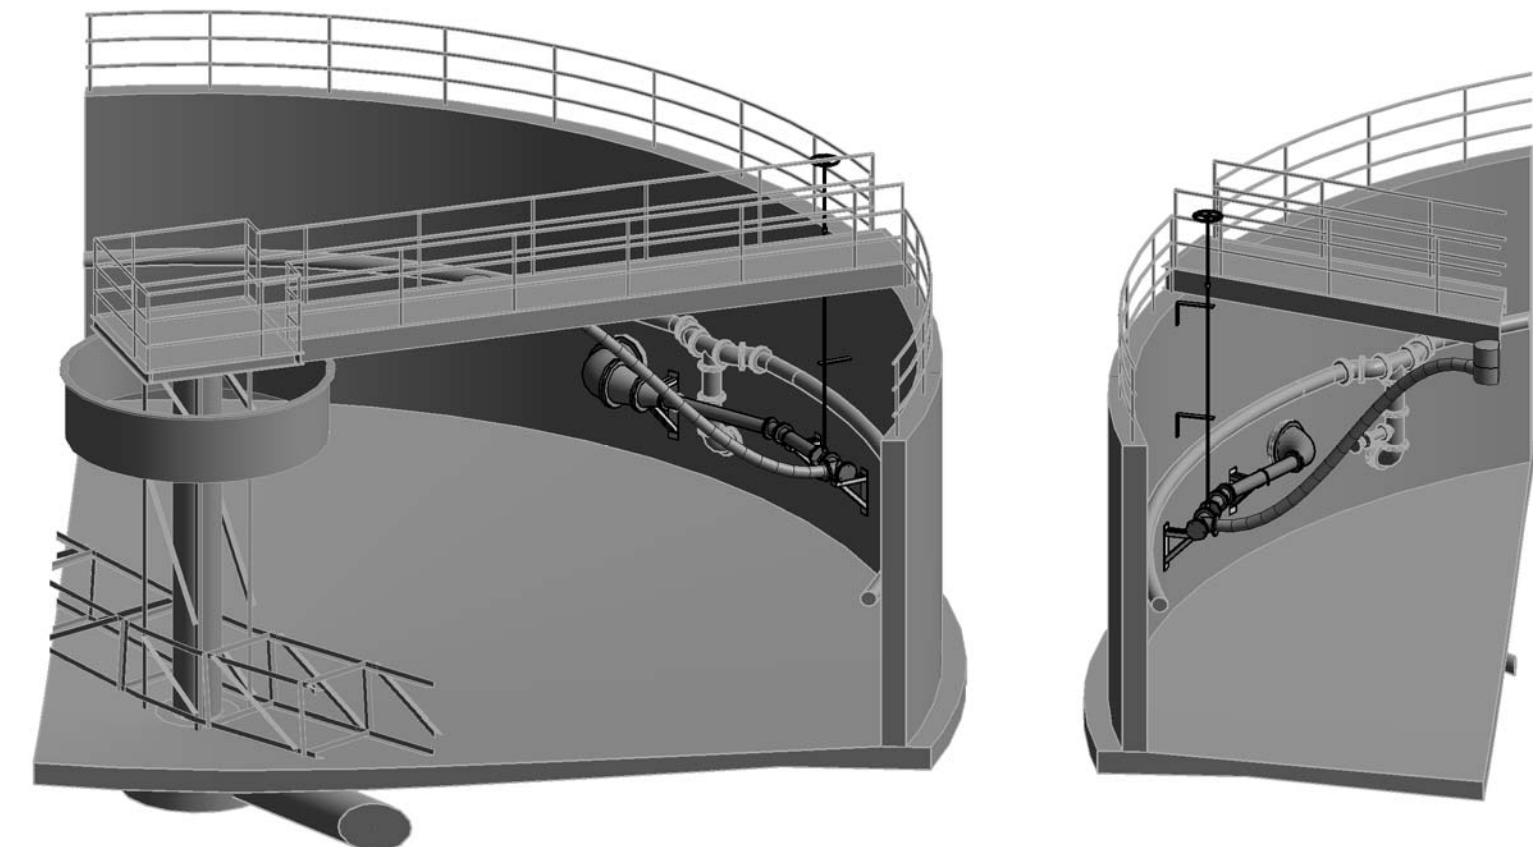

3 3D PROPOSED VIEW
P2

SEH
SOUTH RIVANNA CENTER DR
SPRING LAKE, VA 23060
PHONE: 851-490-2000
FAX: 851-490-2150
WWW.SEHINC.COM



**SOUTH RIVANNA WATER TREATMENT
PLANT CLARIFIER IMPROVEMENT
PROJECT**
RIVANNA WATER & SEWER AUTHORITY
ALBEMARLE COUNTY, VIRGINIA

MARK	DATE	DESCRIPTION
1	05-29-18	ADDITIONAL NO. 2 REVISIONS

FILE NO.	RIVAN145827
RWSA REF. NO.	BID DOCS
PROJECT STATUS	05-10-2018
ISSUE DATE	MBJ
DESIGNED BY	RWF
DRAWN BY	

SHEET TITLE
PROPOSED SECTIONS

SHEET
P2